

# PHOTOMETRIC TEST REPORT

---

WALL BASE 300 LED - 0-10V UL

astro

WALL BASE 300 LED - 0-10V UL

astro


LIGHT EFFICIENCY:



LIGHT QUALITY:



COLOR TEMPERATURE:




OUTPUT: 837 lm  
PEAK: 234 cd  
POWER: 17.3 W  
PF: 0.99



Tracking number: [n/a](#)

Product name:  
Wall base 300 LED - 0-10V UL  
Item number:  
1367005  
Date and time:  
16/10/2025 14:16:55  
Description:

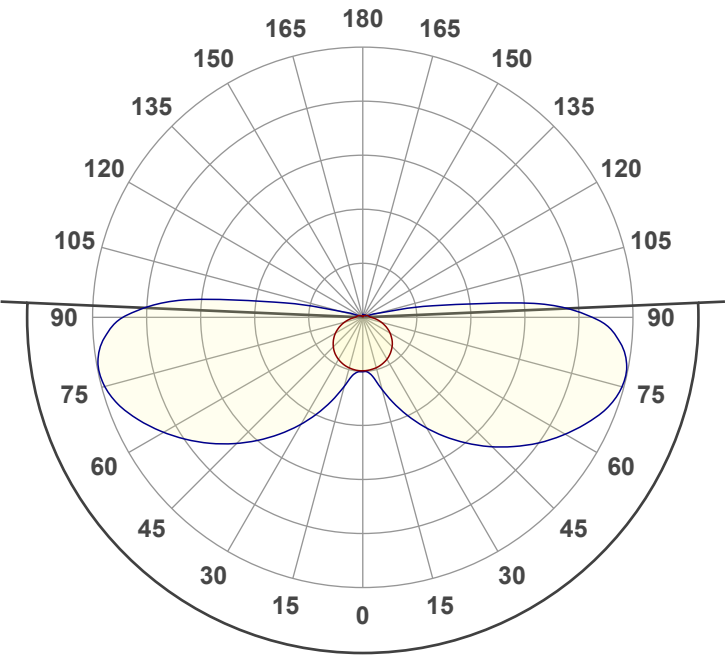


185°




CIE 1931  
x: 0.469  
y: 0.414



SPECTRA

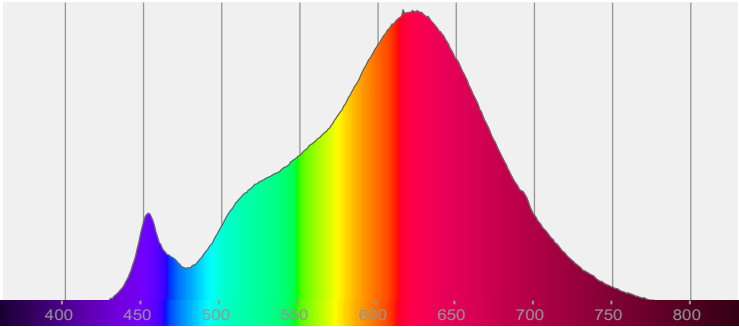

POWER


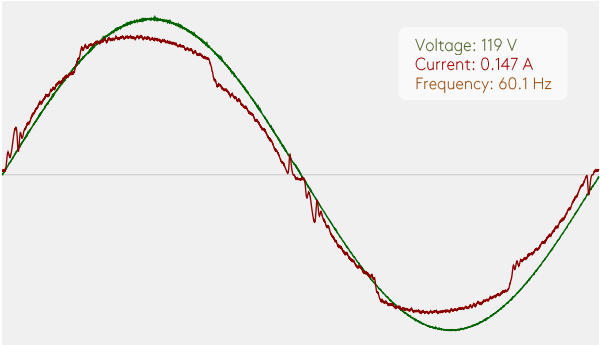


## COLOR DETAILS

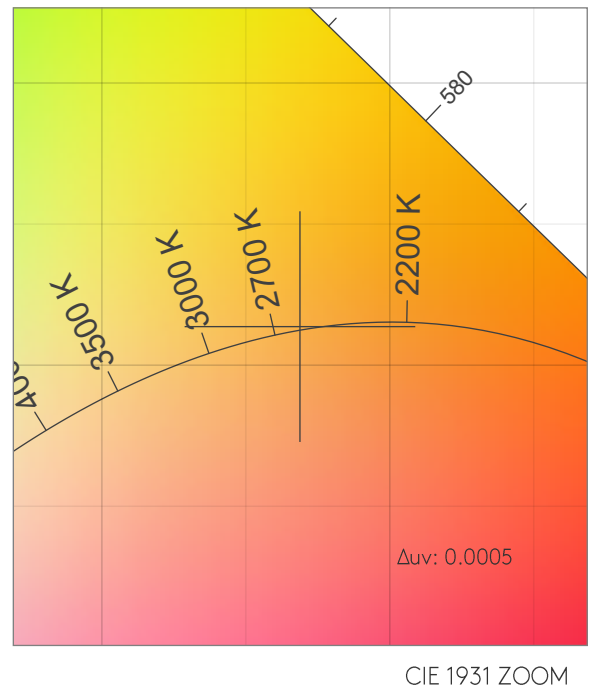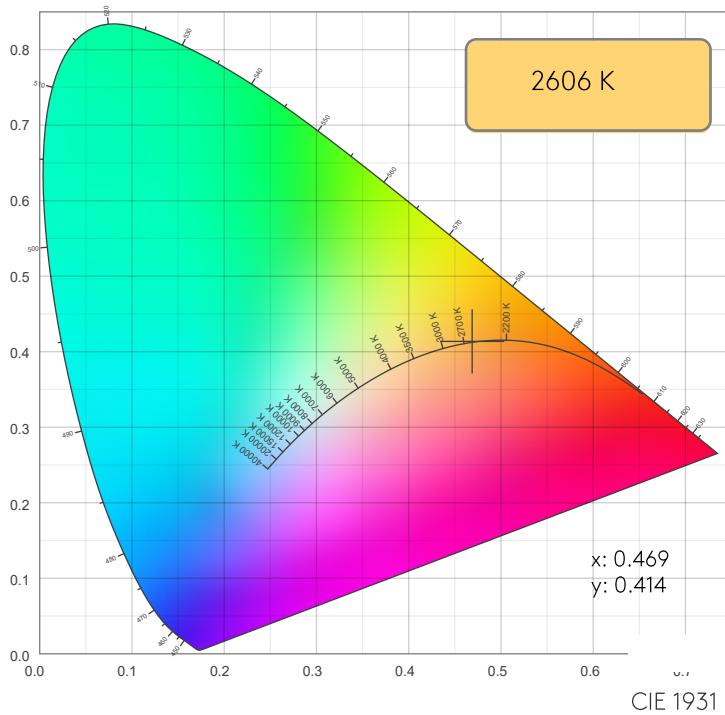

TM30: 92.7

CRI: 93.5 (R1-R8)

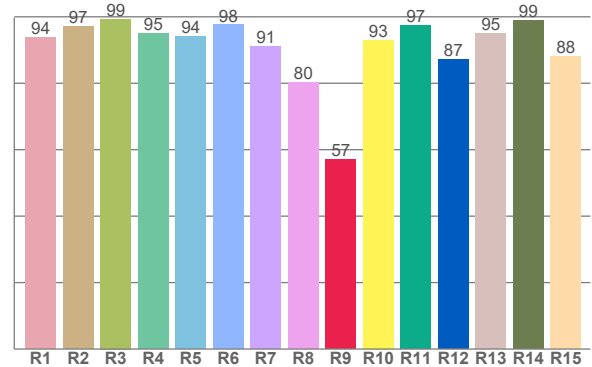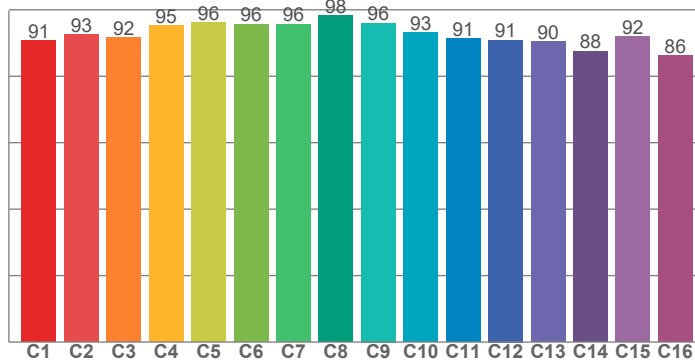

CRI R values, only R1-R8 are used to calculate final CRI value

R1	R2	R3	R4	R5	R6	R7	R8	R9	R10	R11	R12	R13	R14	R15
93.9	97.2	99.3	94.9	94.1	97.6	91.1	80.2	67.1	93.0	97.4	87.1	95.0	98.9	88.0


TM30 C values, 16 binned values out of total of 99 C values

C1	C2	C3	C4	C5	C6	C7	C8	C9	C10	C11	C12	C13	C14	C15	C16
90.7	92.6	91.6	95.3	96.1	95.7	95.7	98.3	96.0	93.2	91.4	90.9	90.5	87.6	92.0	86.2

CQS Q values

Q1	Q2	Q3	Q4	Q5	Q6	Q7	Q8	Q9	Q10	Q11	Q12	Q13	Q14	Q15
86.7	93.9	91.0	91.4	93.2	92.8	92.1	92.7	95.9	94.6	94.4	93.5	92.4	85.5	85.8

CQS: 90.9

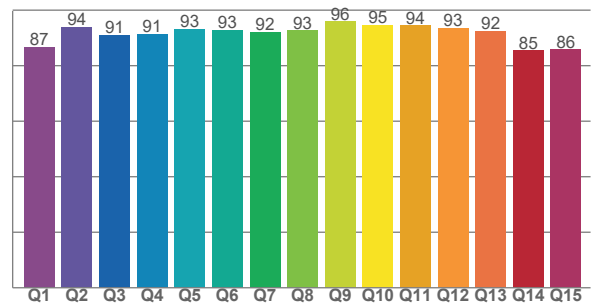

## COLOR PARAMETERS

Color temperature	Color rendering index	Red component	Color fidelity	Color gamut	Color quality scale	Color coordinate cie 1931	Color coordinate cie 1931	Color coordinate	Color coordinate	Color deviation from black body
CCT	CRI	CRI R9	TM30 Rf	TM30 Rg	CQS	x	y	u	v	$\Delta uv$
2606 K	93.5	57.1	92.7	99.2	90.9	0.469	0.414	0.267	0.353	0.0005







Rf 92.7

Fidelity index Rf


Rg 99.2

Gammut index Rg

Hue Bin	Rf	Graphic shifts (%)	
		Chroma	Hue
1	91	-5%	0%
2	93	-3%	2%
3	92	-1%	4%
4	95	-1%	1%
5	96	0%	2%
6	96	2%	1%
7	96	-1%	-2%
8	98	0%	0%
9	96	-1%	1%
10	93	-1%	4%
11	91	2%	5%
12	91	4%	-1%
13	90	3%	-7%
14	88	3%	-10%
15	92	-2%	-4%
16	86	-4%	-10%

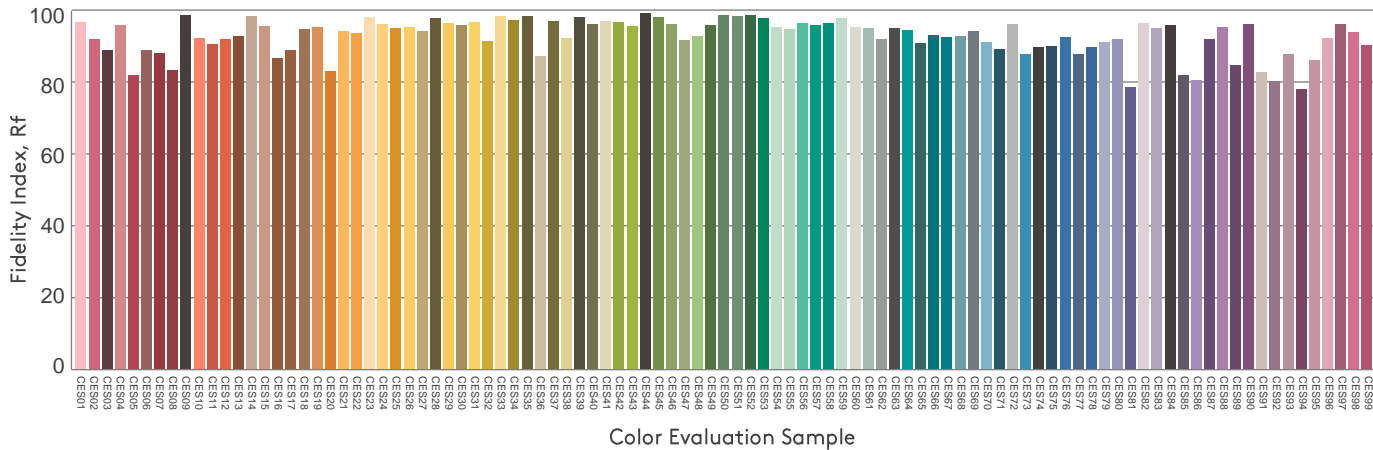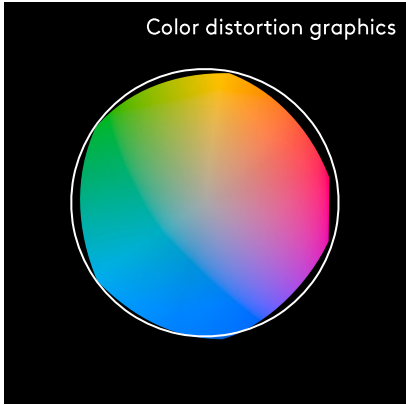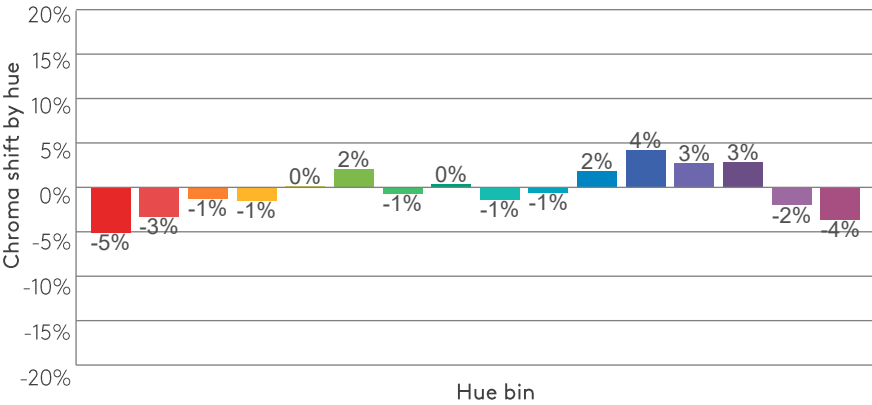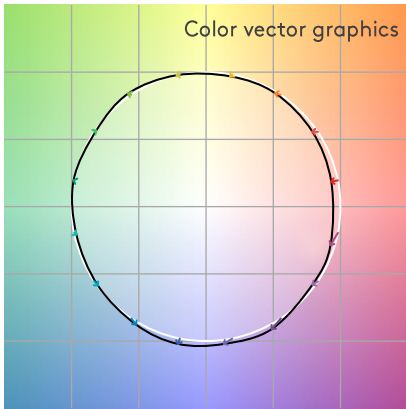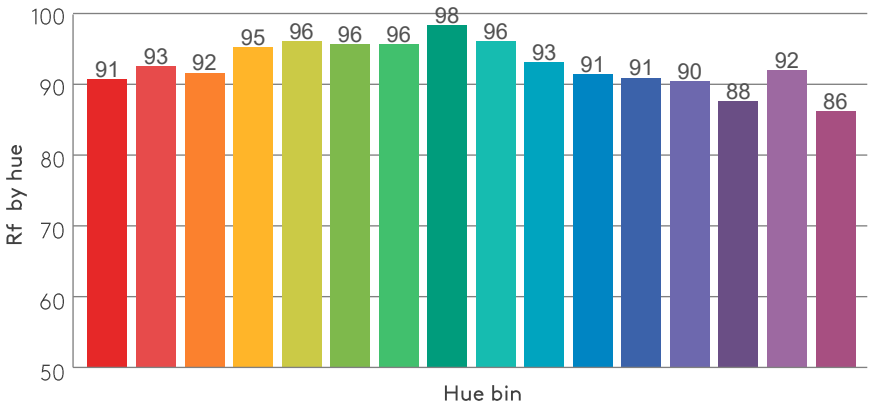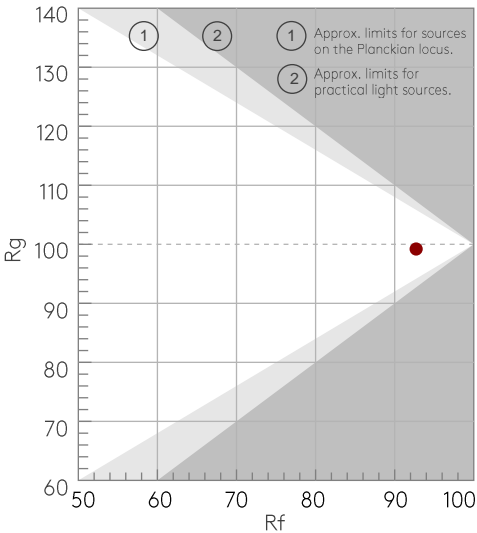

## BEAM DETAILS

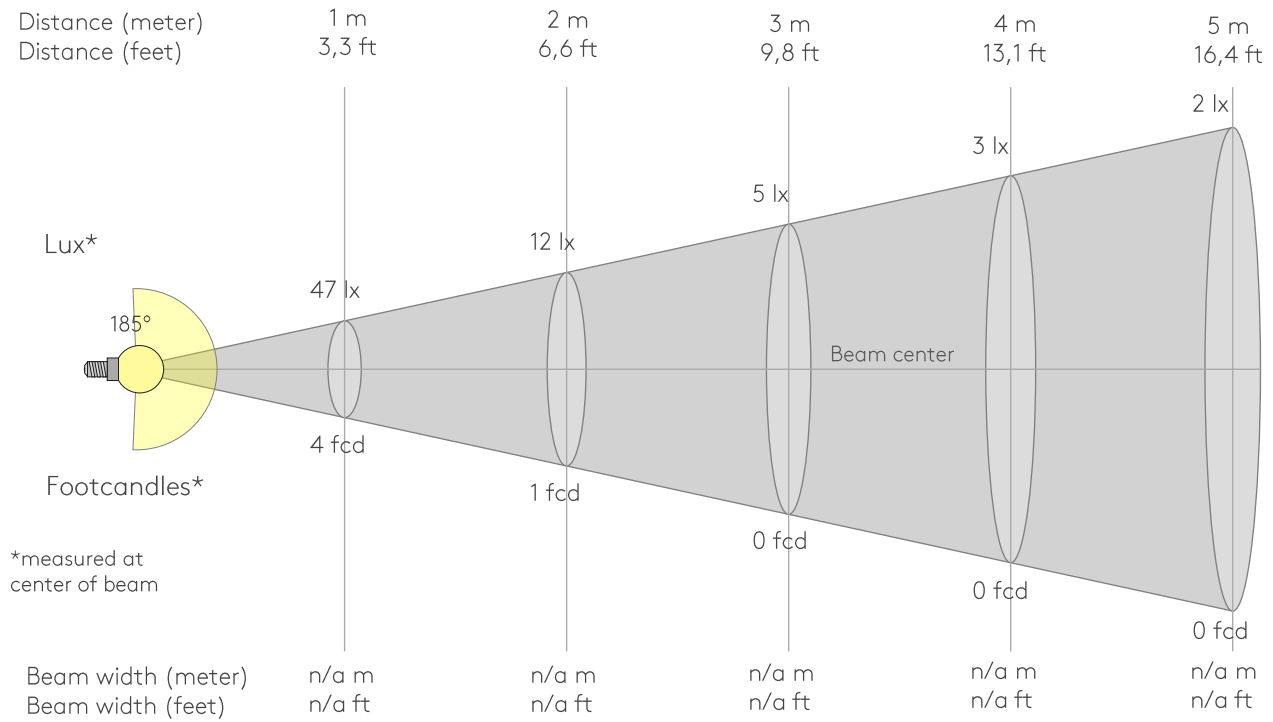

Beam intensities from 1-20m

1m	2m	3m	4m	5m	6m	7m	8m	9m	10m	11m	12m	13m	14m	15m	16m	17m	18m	19m	20m
3.3ft	6.6ft	9.8ft	13.1ft	16.4ft	19.7ft	23ft	26.2ft	29.5ft	32.8ft	36.1ft	39.4ft	42.7ft	45.9ft	49.2ft	52.5ft	55.8ft	59.1ft	62.3ft	65.6ft
47lx	12lx	5lx	3lx	2lx	1lx	1lx	1lx	1lx	0lx	0lx	0lx	0lx	0lx	0lx	0lx	0lx	0lx	0lx	0lx
4.4fcd	1.1fcd	0.5fcd	0.3fcd	0.2fcd	0.1fcd	0.1fcd	0.1fcd	0.1fcd	0fcd	0fcd	0fcd	0fcd	0fcd	0fcd	0fcd	0fcd	0fcd	0fcd	0fcd

Intensities in 0° c-plane

0°	9°	18°	27°	36°	45°	54°	63°	72°	81°	90°	99°	108°	117°	126°	135°	144°	153°	162°	171°
47.0	46.1	45.0	43.0	40.0	36.1	31.2	25.4	19.0	12.7	7.2	5.5	4.6	3.6	2.8	2.1	1.4	1.1	1.1	1.1
100%	98%	96%	91%	85%	77%	66%	54%	40%	27%	15%	12%	10%	8%	6%	4%	3%	2%	2%	2%

Intensities in 90° c-plane

0°	9°	18°	27°	36°	45°	54°	63°	72°	81°	90°	99°	108°	117°	126°	135°	144°	153°	162°	171°
47	52	74	102	131	160	187	212	230	231	199	69	8	3	3	3	3	2	2	2
100%	110%	158%	217%	278%	339%	398%	450%	490%	492%	422%	147%	16%	6%	6%	6%	6%	5%	4%	4%

Intensities in 180° c-plane


0°	9°	18°	27°	36°	45°	54°	63°	72°	81°	90°	99°	108°	117°	126°	135°	144°	153°	162°	171°
47.0	46.3	45.1	43.1	40.3	36.3	31.3	25.3	18.8	12.2	6.8	5.3	4.4	3.4	2.5	1.7	1.2	1.0	1.1	1.1
100%	98%	96%	92%	86%	77%	67%	54%	40%	26%	14%	11%	9%	7%	5%	4%	2%	2%	2%	2%

Intensities in 270° c-plane

0°	9°	18°	27°	36°	45°	54°	63°	72°	81°	90°	99°	108°	117°	126°	135°	144°	153°	162°	171°
47	51	71	98	127	155	183	208	229	233	208	96	12	2	2	2	2	1	1	1
100%	108%	150%	209%	269%	330%	389%	443%	486%	496%	442%	204%	25%	5%	4%	4%	3%	3%	3%	3%

Beam angle 50%	Field angle 10%	Cutoff angle 2,5%	Intensity ratio in 120° cone	Intensity ratio in 90° cone
185°	224.8°	274.4°	34.0%	16.9%


ISO CANDELA DIAGRAM

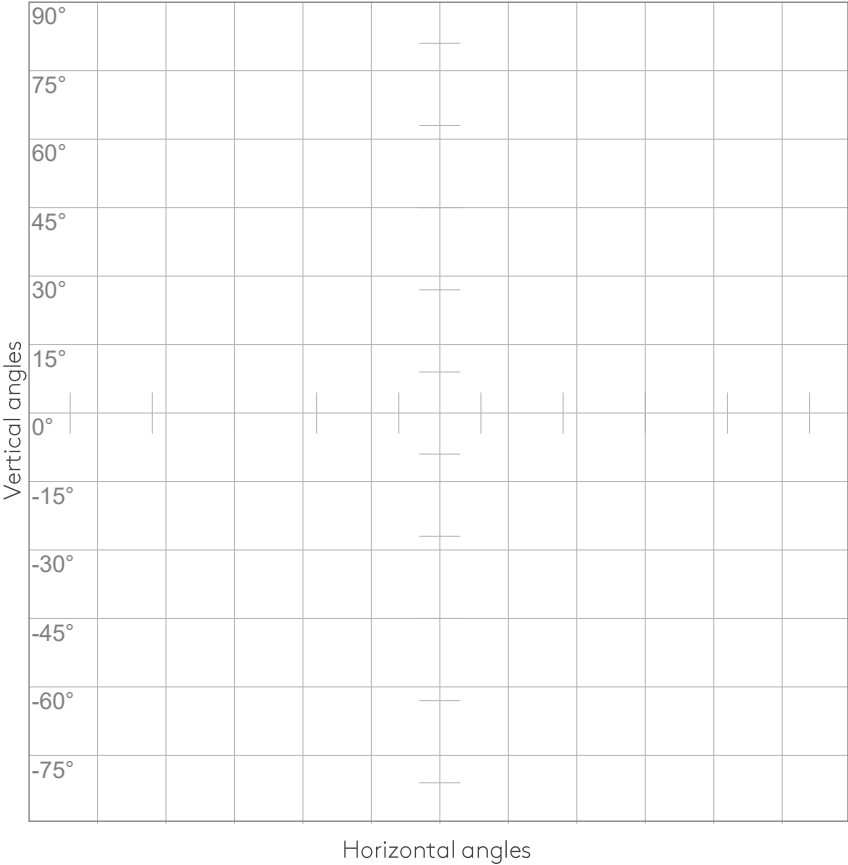

- 10% 5 cd
- 20% 9 cd
- 30% 14 cd
- 40% 19 cd
- 50% 24 cd
- 60% 28 cd
- 70% 33 cd
- 80% 38 cd
- 90% 42 cd

Conditions:  
Number of c-planes: 8  
Candela at center: 47 cd

ISO LUX DIAGRAM

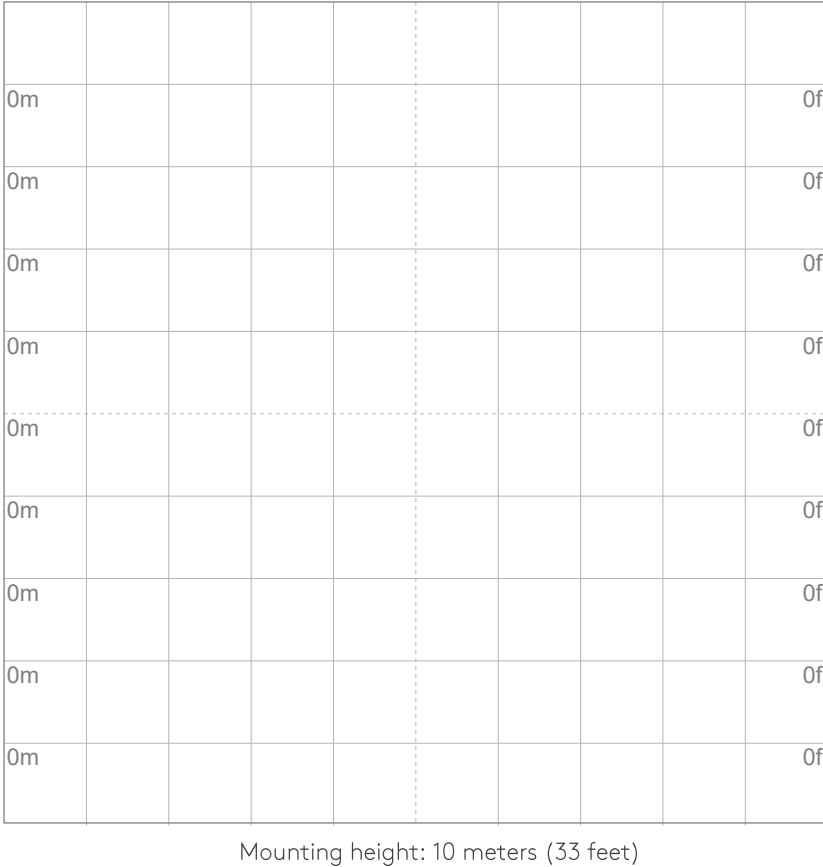

- 3% 14.1m lx
- 5% 23.5m lx
- 10% 47.0m lx
- 30% 0.141 lx
- 50% {LUX\_10M50} lx

Conditions:  
Number of c-planes: 8  
Lux at center: 0.470 lx

Lux distribution on a surface  
when lamp is mounted at 10  
meters from the surface.

## GLARE EVALUATION ACCORDING TO UGR


UGR data could not be calculated due to missing/wrong symmetry. Goto Edit->Photometric->Corrections and select Correct asymmetry.

## COEFFICIENTS OF UTILIZATION

Ceiling reflectance	80				70				50			30			10			0
Wall reflectance	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
Floor reflectance	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	0
RCR	(RCR: Room Cavity Ratio) Room Values are expressed as percentage of Lumens delivered to the task surface																	
0	114	114	114	114	110	110	110	110	100	100	100	92	92	92	84	84	84	81
1	96	88	81	75	91	84	77	71	76	71	66	69	64	60	62	58	55	51
2	84	72	63	54	80	69	60	52	62	54	48	55	49	44	49	44	40	36
3	75	61	50	41	71	58	48	40	52	43	37	46	39	33	41	35	30	27
4	68	52	41	33	63	50	39	32	45	36	29	40	32	26	35	29	24	21
5	61	46	35	27	58	43	33	26	39	30	24	35	27	22	31	25	20	16
6	56	40	30	22	53	38	29	21	34	26	20	31	23	18	27	21	16	13
7	52	36	26	19	49	34	25	18	31	23	17	28	21	15	25	18	14	11
8	48	32	23	16	45	31	22	16	28	20	14	25	18	13	22	16	12	9
9	44	29	20	14	42	28	19	14	25	18	12	23	16	11	21	15	10	8
10	41	27	18	12	39	26	17	12	23	16	11	21	15	10	19	13	9	7

LAMPS (number of lamps)

## LUMINAIRE BUDGETARY DIAGRAM

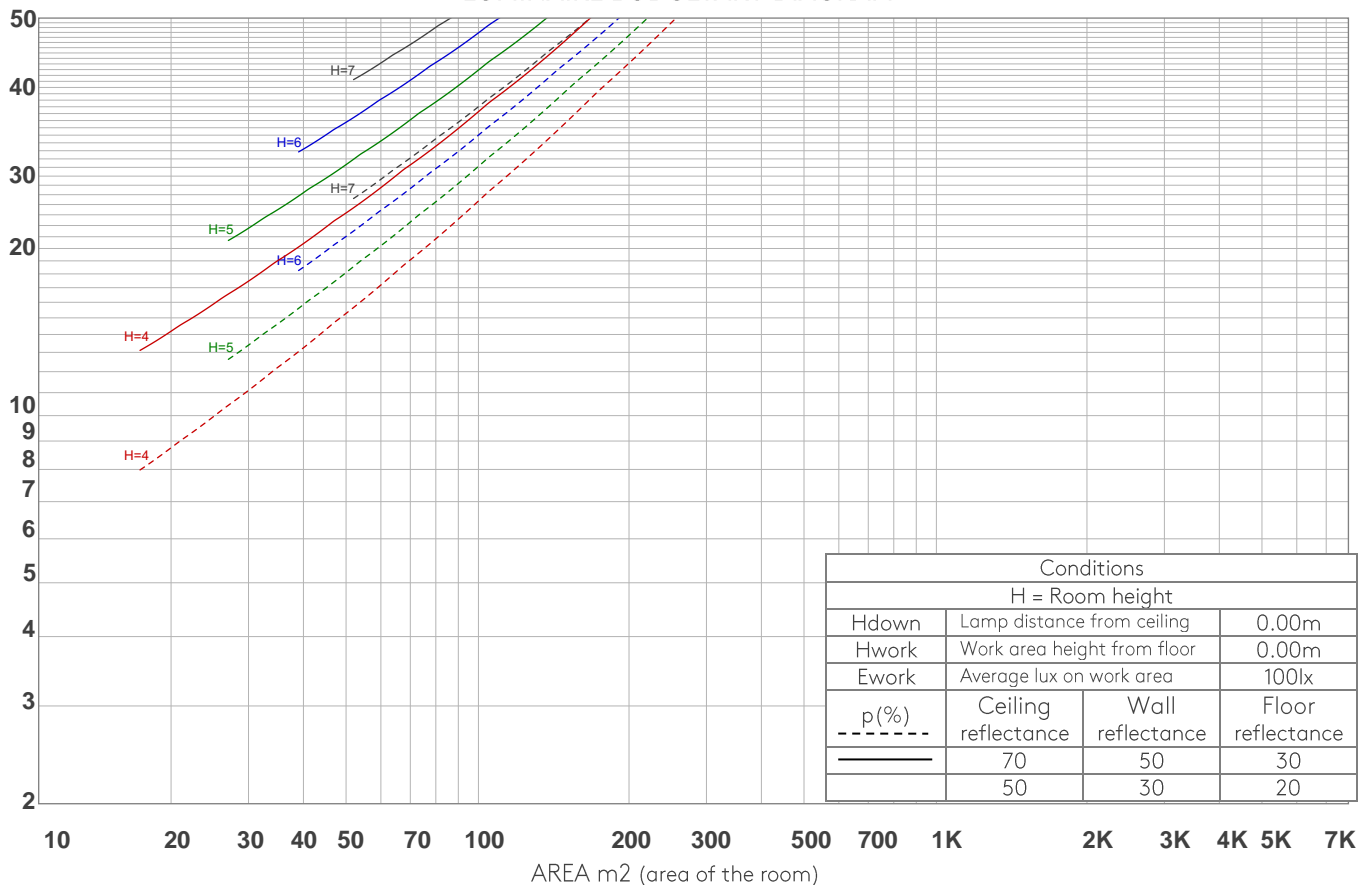


## ZONAL LUMEN SUMMARY

0°-10°	10°-20°	20°-30°	30°-40°	40°-50°	50°-60°	60°-70°	70°-80°	80°-90°
4.55 lm	15.5 lm	32.0 lm	53.4 lm	77.5 lm	102 lm	123 lm	136 lm	133 lm
90°-100°	100°-110°	110°-120°	120°-130°	130°-140°	140°-150°	150°-160°	160°-170°	170°-180°
97.9 lm	40.2 lm	13.9 lm	4.44 lm	1.68 lm	1.02 lm	0.670 lm	0.394 lm	0.131 lm




FLICKER


FLICKER CURVE (COMPLETE SAMPLED)



FLICKER FRAME (FRAME OF ONE FLICKER)

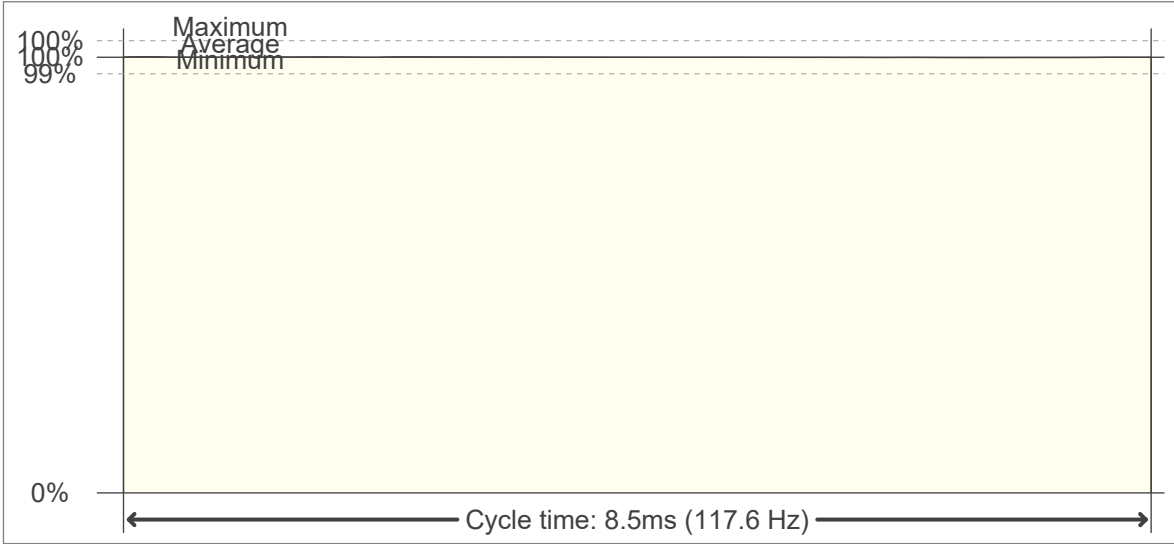

FLICKER FFT (FREQUENCY SCOPE OF FLICKER)

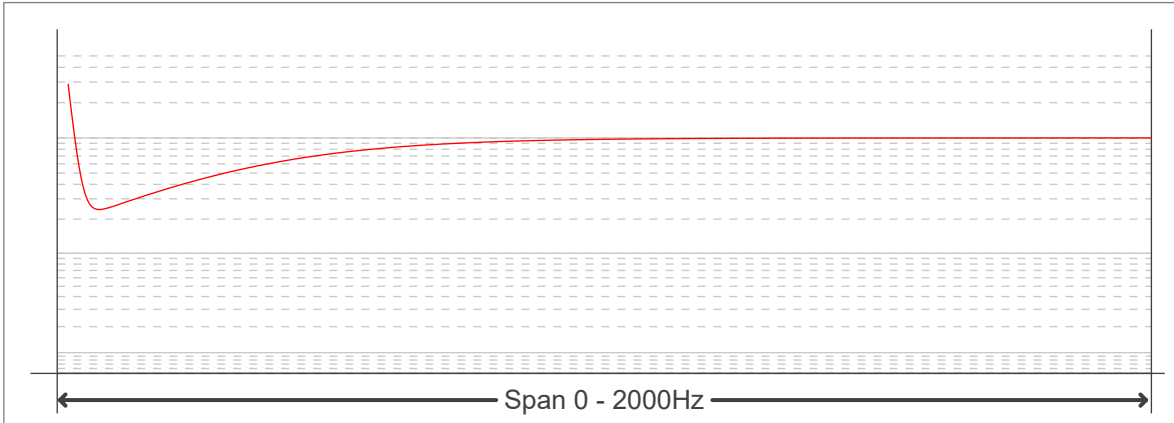

FLICKER RESULTS:

Flicker frequency:	117.65 Hz
Flicker index:	0
Flicker percentage:	0.33 %
SVM: (Visual flicker)	0

FLICKER CONDITIONS:

Sample rate:	20000 samples/second
--------------	----------------------